


# Options and accessories

## Open cooling towers

### Options and accessories

Below is a listing of the main FXT options and accessories. If your required option or accessory is not listed, look no further than your [local BAC representative](#).

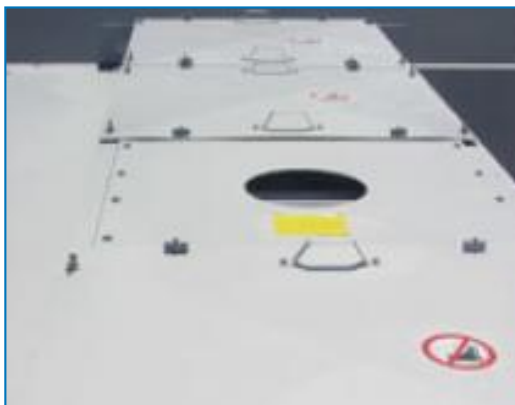

#### Distribution basin covers

Distribution basin covers on unit tops **prevent debris collecting** in unit water distribution basins.



#### Electric water level control package

**For perfectly precise water level control**, replace the standard mechanical valve with our electrical water level controller.




## Basin heater package

Thanks to our factory-installed heaters, the water stays at 4°C and **never freezes**, even during tower downtime and however cold it gets outside.



## Vibration cut out switch

When excessive vibration occurs, this switch shuts down the fan, ensuring your cooling equipment **operates safely**.

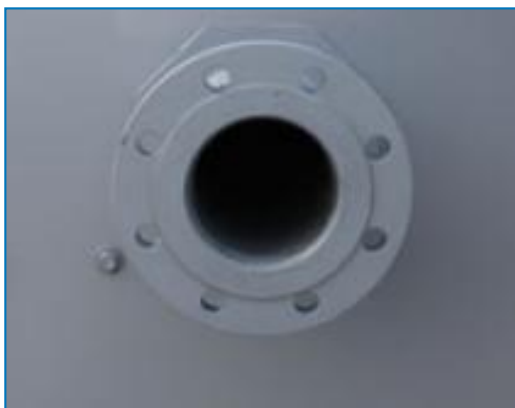

## Flanges

Flanges facilitate **piping connections** on-site.



## Remote sump connection

The best way to **prevent a sump freezing** is to use the auxiliary remote variety within a heated area. Shutting off the circulating pump allows all the water in the water distribution, as well as that in suspension and the sump to drain freely to the auxiliary sump.



## Filter

Separators and media filters efficiently **remove suspended solids** in the recirculating water, reducing system cleaning costs and optimizing water treatment results. Filtration helps you keep the recirculating water clean.



## Sump sweeper piping

Sump sweeper piping **prevents sediment collecting in the cold water basin** of the unit. A complete piping system, including nozzles, is installed in the basin of the tower **for connection to side stream filtration** equipment.



## Water treatment equipment

Devices to control water treatment are needed to ensure proper **cooling tower water care**. Not only does this help protect the components and fill pack, controlling corrosion, scaling and fouling, it also avoids the proliferation of harmful bacteria, including **legionella**, in the recirculating water.